


MOBILE HOME INFORMATION

Street or Driveway

(Front of Mobile Home)

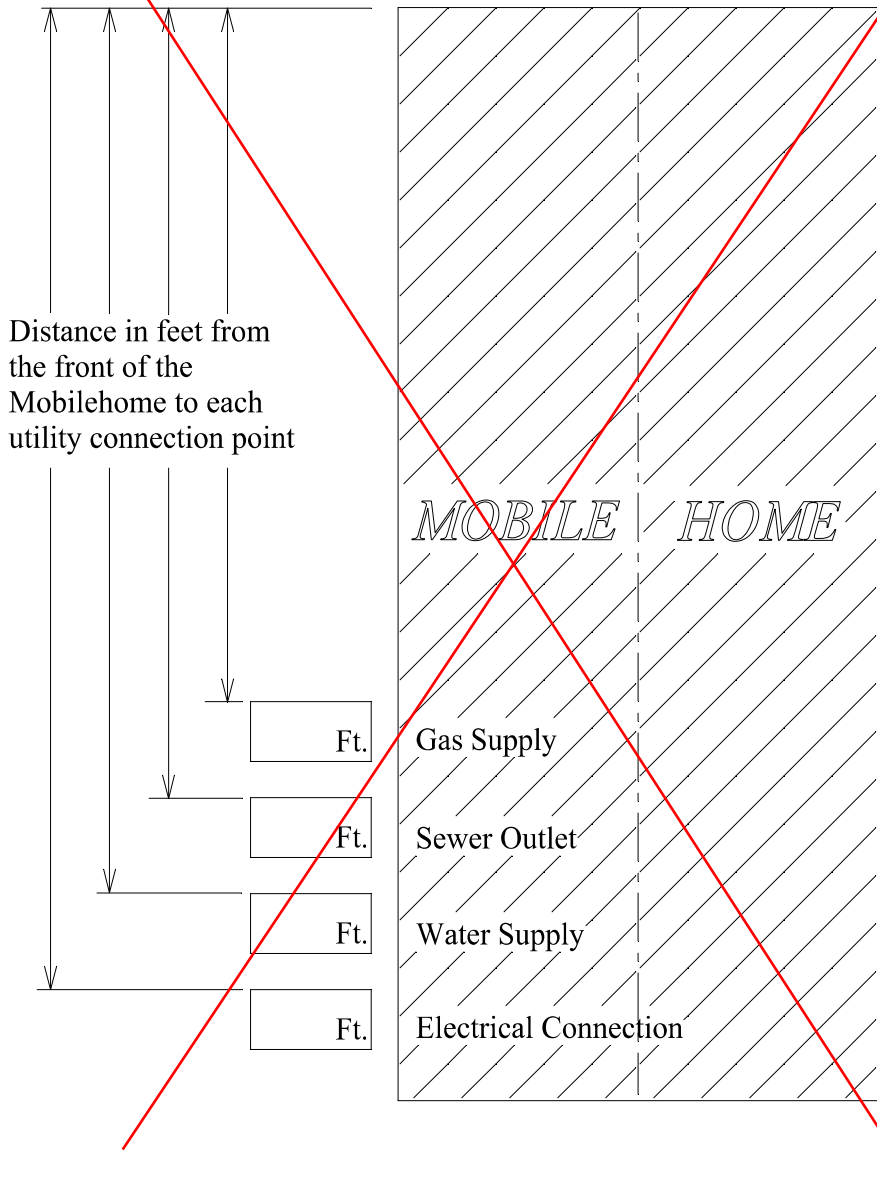

FILL IN THE APPROPRIATE INFORMATION BELOW FOR MOBILEHOME & SITE UTILITY CONNECTIONS

SITE UTILITY SERVICES

Notes: All connections and valves on site for mobilehome utilities shall be located outside the rear 1/3 of the mobile home within 4 (four) feet of the left wall.

- 1.) Gas: Natural _____ LPG _____
Piping & Riser Outside Diameter _____
- 2.) Water Service Line:
Piping & Riser Outside Diameter _____
- 3.) Sewer/Septic Tank:
Waste Line Outside Diameter _____
- 4.) Electrical Service Panel:
Meter Panel Size _____ Amps

MOBILE HOME DATA

- 1.) Single Wide _____ Double Wide _____ Triple Wide _____
- 2.) Size: Length _____ Width _____
- 3.) Electrical: Mobile Home Service Rating _____ Amps
- 4.) Gas Supply Inlet: _____ Outside Diameter
- 5.) Water Supply Inlet: _____ Outside Diameter
- 6.) Sewer Line Outlet: _____ Outside Diameter
- 7.) Mobile Home Manufacturer: _____
Model: _____ Serial Number: _____
HCD State Insignia Numbers: Unit X: _____
Unit Y: _____
Unit Z: _____